

Energy source:

Gas (natural gas, town gas, biogas)

Fuel (diesel, waste oil)

Exhaust gas 300-500 C

Hot water 90-180 C

Steam 1-8 Bar (120-180 C)

Combined

Chilled water (for air conditioning):

Output 7 - 10 C (min 5 C)

Return 12 - 14 C


Chilled water (heat pump application):

Output

(As requirement, normally from 20C+)

Return

(As requirement)

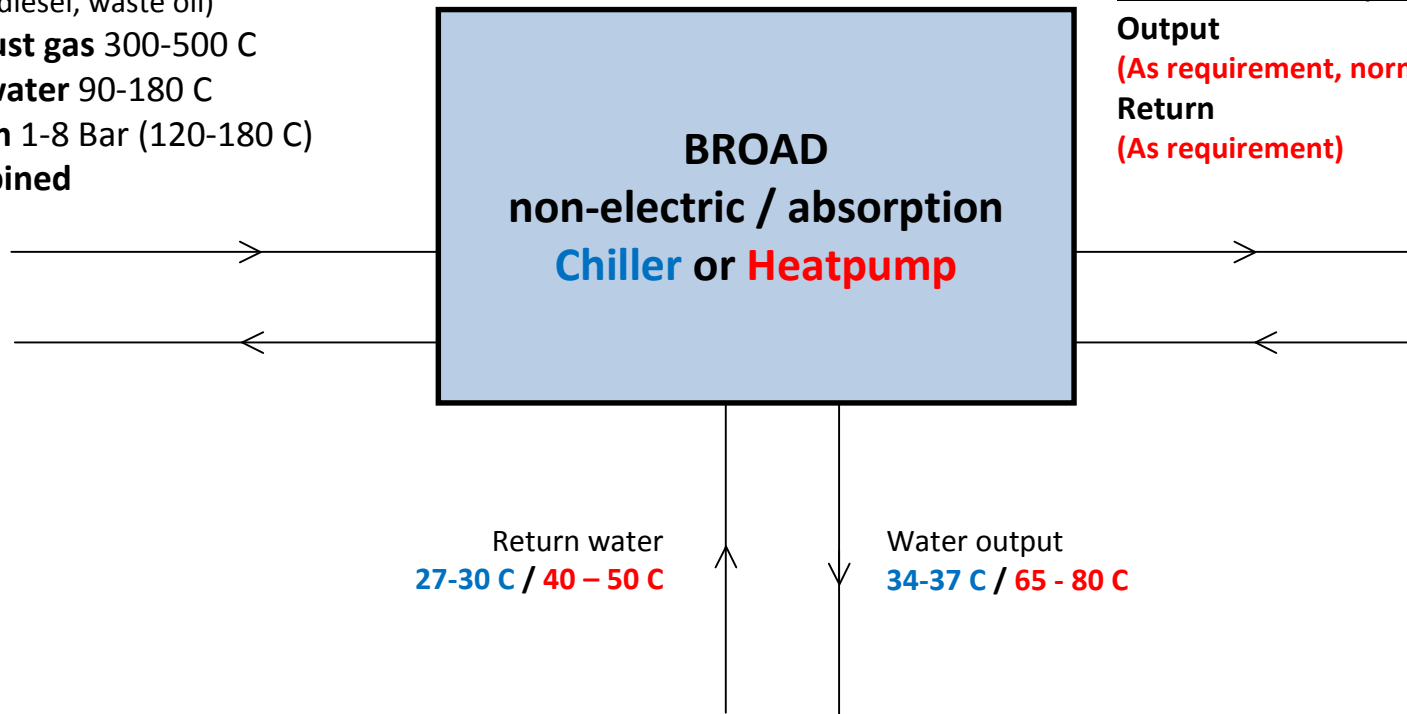

Cooling water :

For chiller application - cooled by **Cooling Tower**

For Heatpump application - used to **supply hot water**